



# Testa protokols

Pasūtījums PD6\_izklašanas

Serija: K1

Tests: Compression test

Izgatavosanas datums: 25.11.2020 11:29

Standarts: EN 12390-3:2009

Parauga vecums: 56 00:28

Paraugs: Cube 150x150x150

Testa datums: 20.01.2021 11:57

Concrete class-----

Testus veica: A. Dandens


-----

Quality result conformity EN 206:2013: not possible

Pasūtītājs U. Skadinš


Name	Length [mm]	Width [mm]	Height [mm]	Weight [g]	Bulk density [kg/m <sup>3</sup> ]	Breakload [kN]	Strength [MPa]
1	152	150	150	8100	2360	919,3	40,3
	Break type:						
2	151	151	150	8100	2360	915,7	40,7
	Break type:						
3	152	150	150	8100	2370	963,4	42,3
	Break type:						
4	152	150	150	8100	2360	965,9	42,3
	Break type:						
Average					2360	41,4	
Std. dev					3,18	1,05	

## Paraugs 1

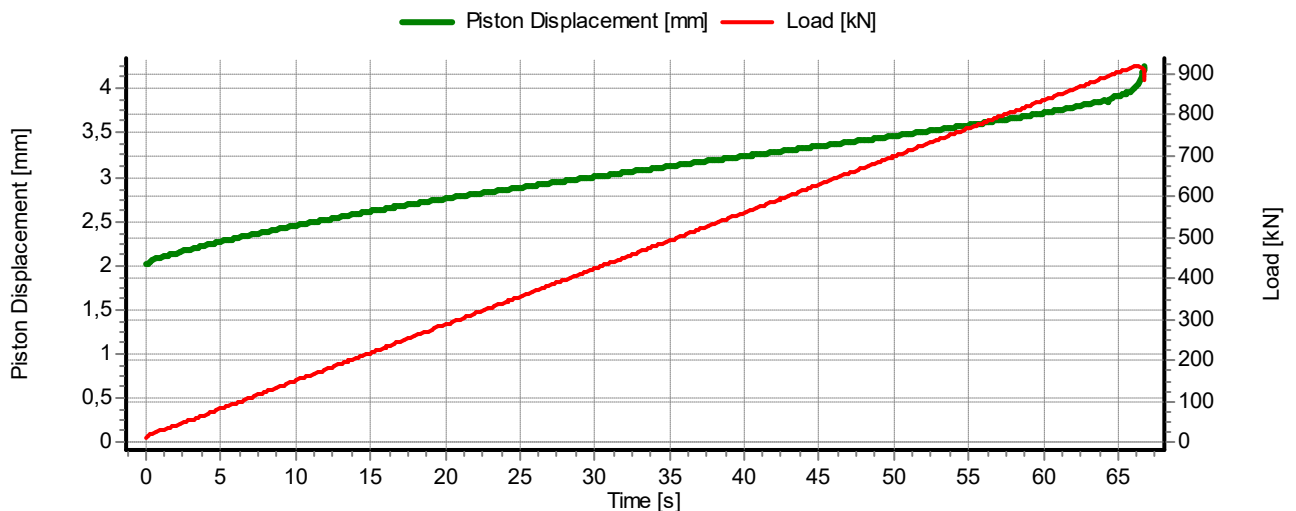




## Paraugs 2

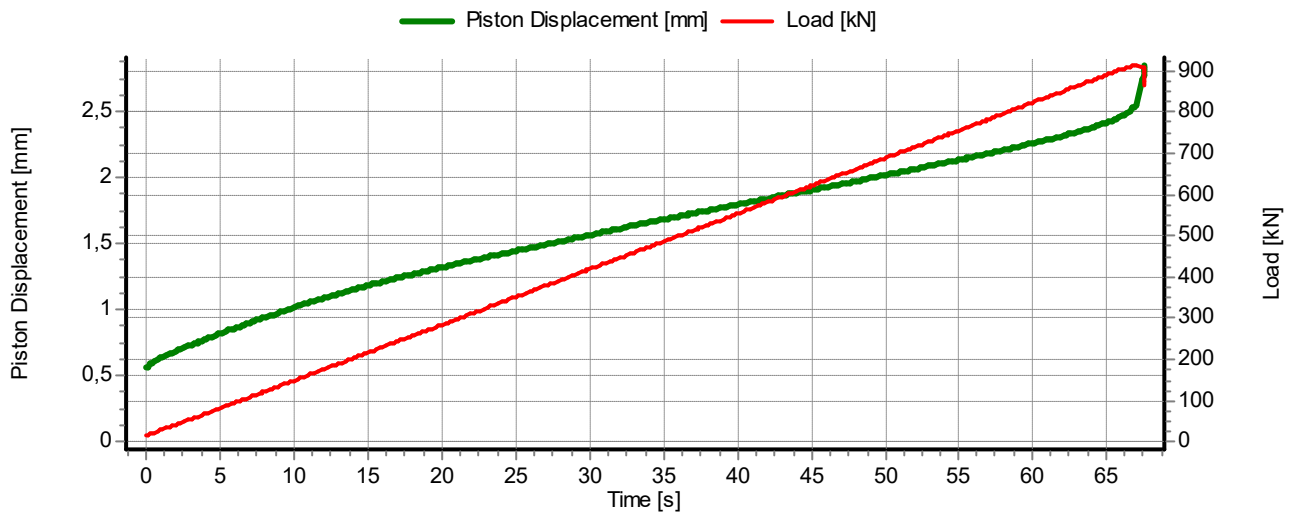

## Paraugs 3

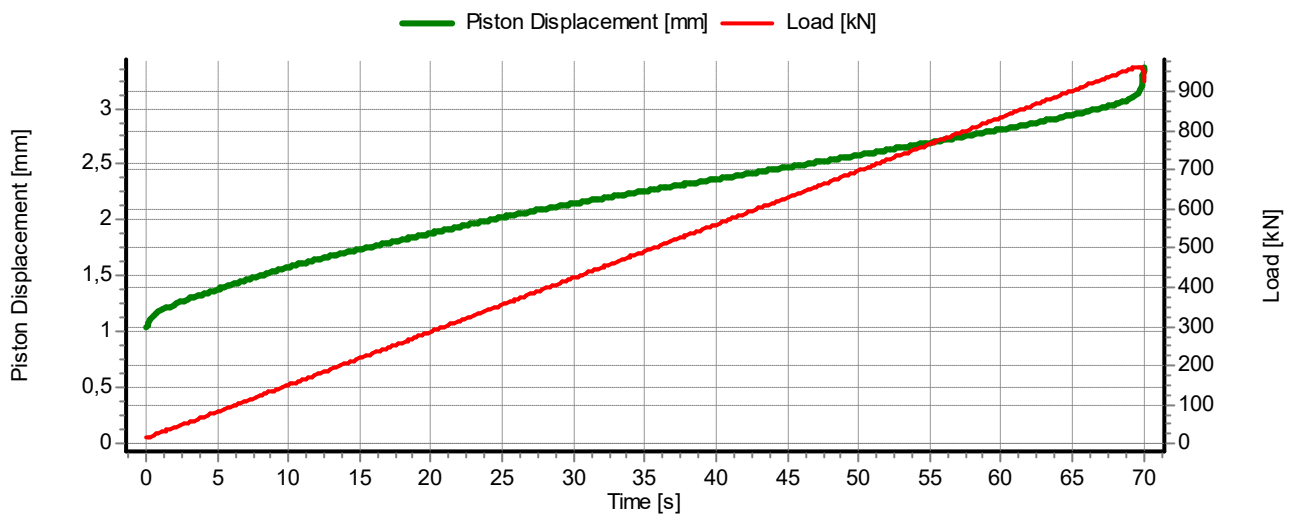

## Paraugs 4

