



# Testa protokols

## Pasūtījums PD6\_izklašanas

**Serija:** K3

**Tests:** Compression test

Izgatavosanas datums: 25.11.2020 19:08

**Standarts:** EN 12390-3:2009

Parauga vecums: 49 00:50

**Paraugs:** Cube 150x150x150

Testa datums: 13.01.2021 19:58

**Concrete class**-----

Testus veica: A. Dandens


-----

**Quality result conformity EN 206:2013:** not possible

Pasūtītājs U. Skadinš


Name	Length [mm]	Width [mm]	Height [mm]	Weight [g]	Bulk density [kg/m <sup>3</sup> ]	Breakload [kN]	Strength [MPa]
1	150	151	150	8100	2390	955,6	42,5
	Break type:						
2	150	150	150	8100	2400	955,8	42,5
	Break type:						
3	150	150	151	8100	2380	1009,3	44,9
	Break type:						
4	150	150	150	8100	2380	1021,7	45,4
	Break type:						
Average					2390		43,8
Std. dev					8,62		1,55

## Paraugs 1

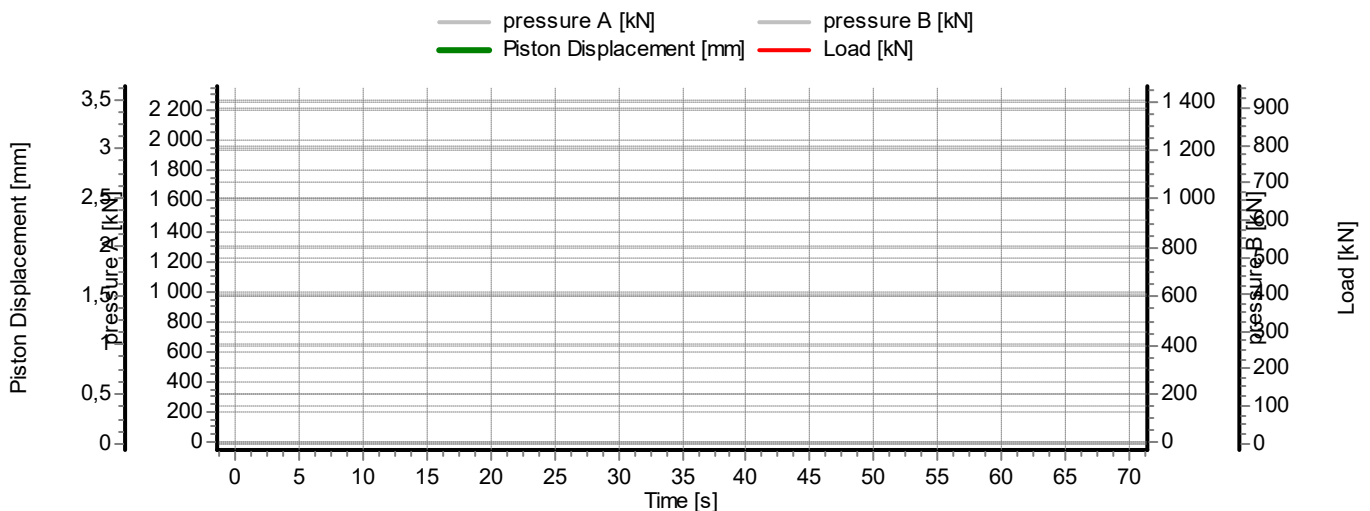




## Paraugs 2

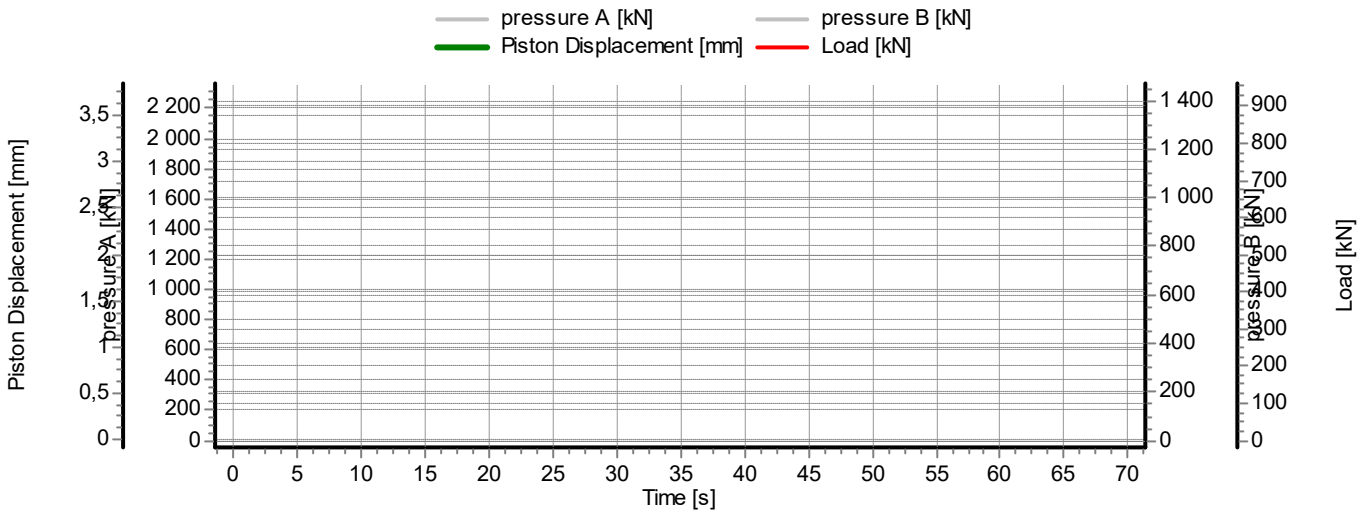

## Paraugs 3

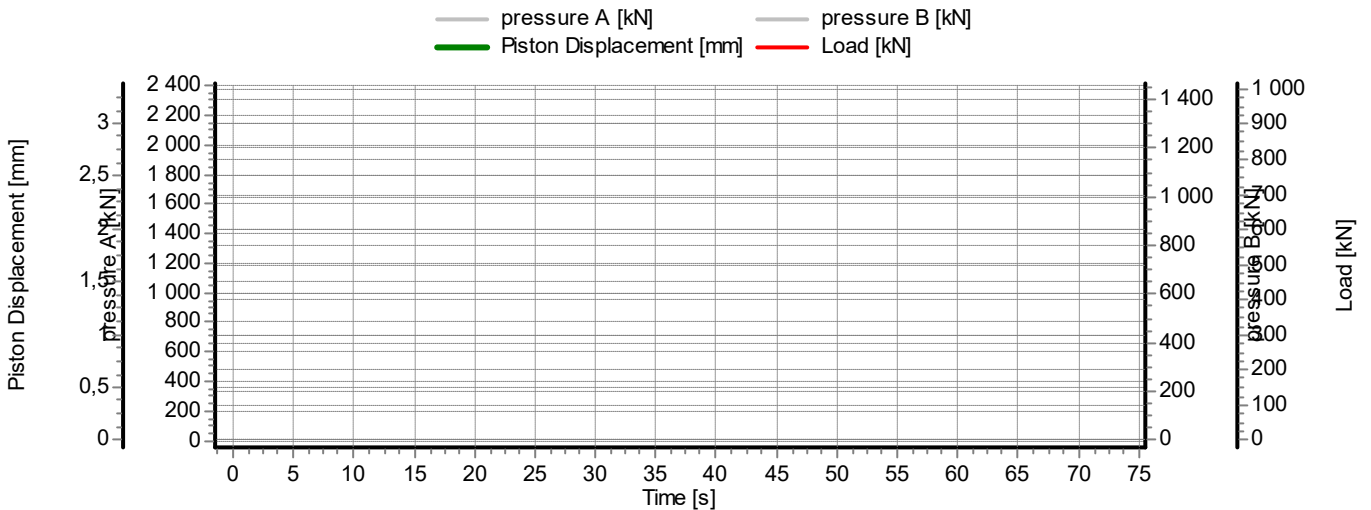

## Paraugs 4

